

PERMIT TO INSTALL REPAIR, REASONS FOR REJECTION
WATER SUPPLY SEWAGE DISPOSAL SYSTEM

(1) After (12) twelve months. (2) Automatically cancelled when site conditions are changed from those shown on permit.
 (3) Automatically cancelled should facts later become known that a potential hazard would be created by continuing installation.

FHA/VA Yes No Date 5/13/77 Case No. _____

Owner Richard J. Daly Address Lake Anna Land Coop. Phone 894-5452
P. O. Box 128 Mineral, VA
 Occupant _____ Address _____ Phone _____
 (Mailing Address)

Exact Location of premises McCoy Subdivision - Lot #20
 (Subdivision, Street or Road Name, Section or Lot No.)

FOR: Dwelling Other _____ Automatic Washing Machine Yes No Consumption 600 gal. per day
 Actual Potential Bedrooms 3 Garbage Disposal Unit Yes No (Actual estimated Water)
 Additional wastes 2 Baths

(1) WATER SUPPLY (Existing) Class _____ Approved Yes No Other _____
 (To be installed) Class III Cased 20 ft. to be grouted. 20 ft.

(Unless supported by positive evidence Class III is to be considered as to be installed.)

(2) SOIL STUDY Naturally drained, suitable by sight Yes No Technical Classification 1/A (If Known)
 Estimated Percolation Rate 1-10 11-25 26-50 > 51 Percolation Test Required Yes No Rate _____
 (Minutes per inch) Depth to Grey Mottles > 60 inches (estimate over 4 ft.) OTHER _____
 Surface drainage required Yes No OTHER DRAINAGE _____


(3) HOUSE SEWER LINE Size 4 inches. Type of material required PLAST. Distance from Water Supply 50 feet.

(4) DETAILS OF CONSTRUCTION Watertight Septic Tank of CONCRETE Material Liquid Capacity 1000 gallons.
 Inside Dimensions Length 8 feet. Width 4 feet. Liquid Depth 4 feet. Depth of Air Space 1 feet.

SUBSURFACE ABSORPTION FIELD Number of square feet required 1000 Type aggregate required CRUSHED STONE

(5) Depth of aggregate from base of tile to bottom of ditches 6 inches. Allowable fall 2 to 4 inches.
 Total aggregate minimum depth 13 inches or more. Depth of drainfield to be 36 inches from surface of original ground.
 Distance from well to septic tank 50 feet; distance from well to drainfield 100 feet. MINIMUM DISTANCE

Rough Sketch of Premises (including adjacent properties if pertinent, Showing Location of Lot Line, Buildings, Water Supplies, Sewage Disposal Systems, Trees, and Other Possible Sources of Contamination of Water Supplies, by Indicating Distances and Slope with regard to one another.

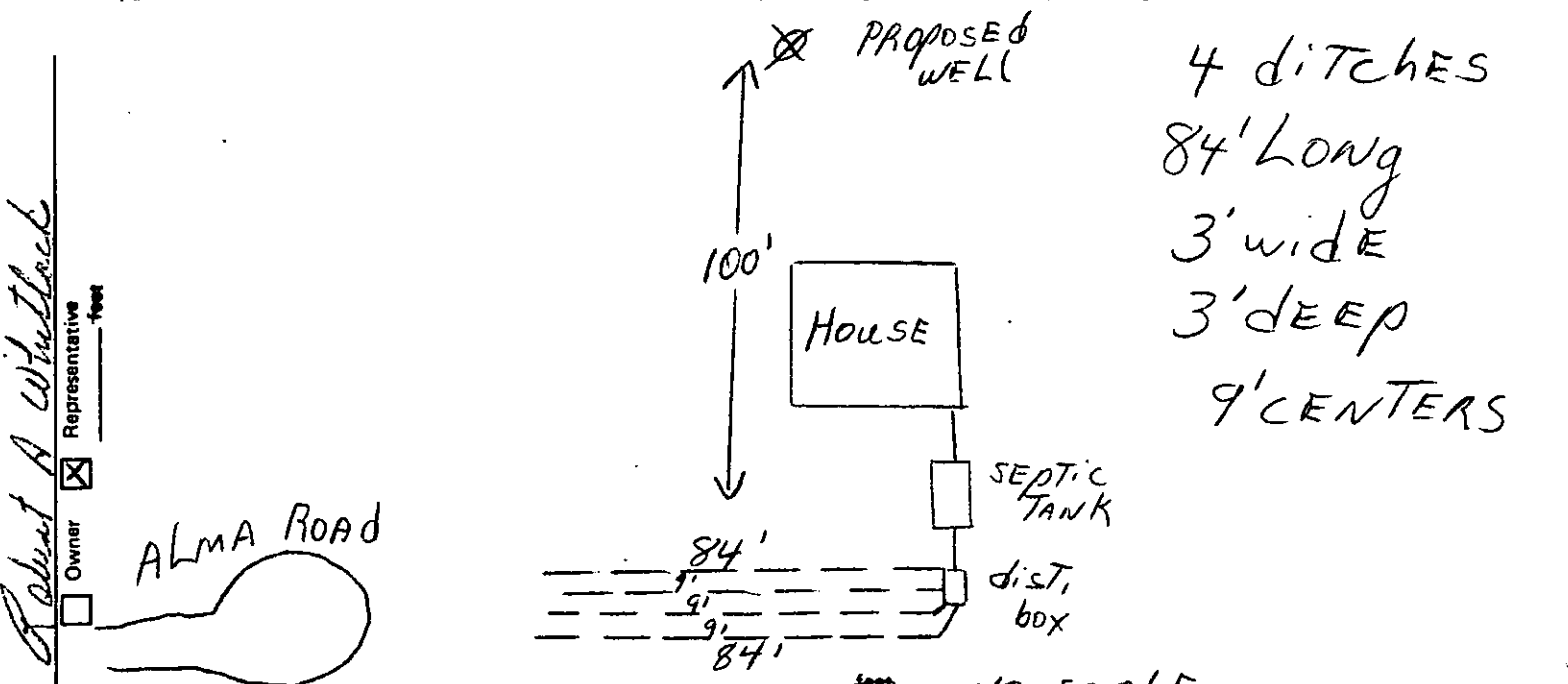

Note: Owner or his agent must notify LOUISA Health Department, Phone 967-0770 when installation is ready for inspection. If any Sewage Disposal System, or part thereof, is covered before being inspected by the Health Department, it shall be uncovered at the direction of the Health Director or his agent. CONDITIONS DISCOVERED DURING INSTALLATION MAY REQUIRE ADJUSTMENTS OF SYSTEM DESIGN. Changes from above specifications require Health Department approval before being made.

Based on the above information, the undersigned recommends that this permit be issued.

Date _____ Approved _____ Date 5/16/77 Signed Donald B. Staackler
 (Reviewing Authority) (Sanitarian of Health Director)

770000

10/10/41

10/10/41 10/10/41

10/10/41 10/10/41

10/10/41 10/10/41

10/10/41

10/10/41

10/10/41

10/10/41

10/10/41

10/10/41

10/10/41

10/10/41

10/10/41

10/10/41

10/10/41

10/10/41