

# RECORD OF INSPECTION-SEWAGE DISPOSAL SYSTEM

Date 3-19-76 Case No. 20-30

Owner J. M. Cline Address Rt. 1, Union Level, Va. Phone \_\_\_\_\_  
(Mailing Address)  
Occupant same Address \_\_\_\_\_ Phone \_\_\_\_\_  
(Mailing Address)

Exact Location of Premises From Victoria east on Rte. 40 to Rte. 635, right approx. 12 1/2 miles on left house.  
(Subdivision, Street or Road Name, Section or Lot No.)

## WATER SUPPLY INSPECTION

Installed according to Permit Design ☐ Yes ☐ No. Distance to nearest House Sewer 100 feet. Distance to nearest Sewage Disposal System 100 feet. (Use Form LHS-143 for Detailed inspection of Water Supply Reference Materials.)

## SEWAGE DISPOSAL SYSTEM INSPECTION

- (1) LOCATION  
Allotted Area adequate ☒ Yes ☐ No. Distance from nearest lot lines 100 feet. Trees 15 feet. Water Supplies 100 feet. Buildings 10 feet.
- (2) INSTALLATION AND DESIGN  
Installed according to Permit Design ☒ Yes ☐ No  
Have additional Household Appliances been added NOT on Permit:  
☐ Automatic Washer ☐ Garbage Disposal  
☐ Other \_\_\_\_\_ (Describe)
- (3) SOIL CONDITION  
Are there soil conditions now evident which indicate system may be unsatisfactory as designed: ☐ Yes ☒ No. If Yes, show adjustments required under "Remarks" below.
- (4) HOUSE SEWER LINE  
Installed ☒ Yes ☐ No. Type of material PVC-40  
Size 4 Inches.
- (5) SEPTIC TANK  
Constructed of pre-cast concrete (Kind of Material)  
Inside Dimensions Length 8 feet. Width 4 feet.  
Liquid Depth 4 feet. Depth of Air Space 12 inches.  
Inside Fittings comply with requirements ☒ Yes ☐ No.
- (6) DISTRIBUTION BOX  
Watertight and equal surcharge to each line by Water Test ☒ Yes ☐ No. Distribution Box provided with \_\_\_\_\_ (Number) extra outlets for future use.
- (7) SUBSURFACE ABSORPTION FIELD  
Total Area in bottom of ditches 720 square feet.  
Number of ditches 3 Length of ditches 240 feet.  
Grade of ditches Minimum 2 Inches per 100 feet.  
Maximum 4 inches per 100 feet. Has system been checked by instruments (Level) ☒ Yes ☐ No  
Type aggregate used gravel  
Depth of aggregate under Tile 6 inches  
Total depth of aggregate 13 inches  
Depth of backfill over aggregate 32-38 inches
- (8) SURFACE DRAINAGE  
Storm Drains from House and Basement flowing away from Subsurface Drainage Field: ☒ Yes ☐ No. Was Surface Drainage required ☐ Yes ☒ No. If Yes, has this been provided ☐ Yes ☐ No. Has area been drained by lowering Ground Water Table: ☐ Yes ☐ No. ☒ Not required.
- (9) Are follow-up inspections necessary ☐ Yes ☒ No.

Septic Tank Contractor: R.O. Bentley, Inc. Address Kerbedy, Va. Phone \_\_\_\_\_  
This Sewage Disposal System (Is) (Is Not) Approved by Princeton County Health Department.  
Date 5-25-77 Signed S.E. King (Sanitarian) Date \_\_\_\_\_ Approved \_\_\_\_\_ (Health Director)  
Date 6-9-76 Approved \_\_\_\_\_ (Advisory Sanitarian) Date \_\_\_\_\_ Approved \_\_\_\_\_ (Reviewing Authority — Other Agency)

With proper maintenance, approved Sewage Disposal systems may be expected to function satisfactorily, provided no overloading or physical damage occurs to the system. Remarks: \_\_\_\_\_



# PERMIT TO INSTALL ☒ REPAIR, ☐ REASONS FOR REJECTION ☐ WATER SUPPLY ☒ SEWAGE DISPOSAL SYSTEM ☒

(1) Void after (12) twelve months. (2) Automatically cancelled when site conditions are changed from those shown on permit.  
 (3) Automatically cancelled should facts later become known that a potential hazard would be created by continuing installation.

FHA/VA ☐ Yes ☐ No Date 3-19-76 Case No. 20-30  
 Owner J. M. Cline Address Pt 1, Union Level, Va Phone \_\_\_\_\_  
 (Mailing Address)  
 Occupant same Address \_\_\_\_\_ Phone \_\_\_\_\_  
 (Mailing Address)

Exact Location of premises from Victoria east on Rte 40 to Rte 635 right approx 12 1/2 miles on left  
 (Subdivision, Street or Road Name, Section or Lot No.)

FOR: ☒ Dwelling ☐ Other \_\_\_\_\_ Automatic Washing Machine ☒ Yes ☐ No Consumption zero gal. per day  
 Actual ☒ Potential ☐ Bedrooms 2 Garbage Disposal Unit ☐ Yes ☒ No ( ☐ Actual ☒ estimated Water )  
 Additional wastes all waste to septic tank

(1) WATER SUPPLY (Existing) Class \_\_\_\_\_ Approved ☐ Yes ☐ No Other \_\_\_\_\_  
 (To be installed) Class III Cased 50 ft. to be grouted 10+ feet  
 or to rock  
 (Unless supported by positive evidence Class III is to be considered as to be installed.)

(2) SOIL STUDY Naturally drained, suitable by sight ☒ Yes ☐ No Technical Classification \_\_\_\_\_ (If Known)  
 Estimated Percolation Rate 1-10 ☐ 11-25 ☐ 26-50 ☒ > 51 ☐ Percolation Test Required ☐ Yes ☒ No ☐ Rate \_\_\_\_\_  
 (Minutes per inch) (Minutes per inch to nearest 10 minutes)  
 Depth to Grey Mottles \_\_\_\_\_ inches (estimate over 4 ft.) OTHER \_\_\_\_\_  
 Surface drainage required ☐ Yes ☒ No OTHER DRAINAGE \_\_\_\_\_


(3) HOUSE SEWER LINE Size 4 inches. Type of material required PVC-40 Distance from Water Supply 100 feet.

(4) DETAILS OF CONSTRUCTION Watertight Septic Tank of concrete Material Liquid Capacity 1000 gallons.  
 Inside Dimensions Length 8 feet. Width 4 feet. Liquid Depth 4 feet. Depth of Air Space 1- feet.

SUBSURFACE ABSORPTION FIELD Number of square feet required 720 Type aggregate required gravel

(5) Depth of aggregate from base of tile to bottom of ditches 6 inches. Allowable fall 2 to 4 inches.  
 Total aggregate minimum depth 13 inches or more. Depth of drainfield to be 48 inches from surface of original ground.  
 Distance from well to septic tank 100 feet; distance from well to drainfield 100+ feet.

Rough Sketch of Premises (including adjacent properties if pertinent, Showing Location of Lot Line, Buildings, Water Supplies, Sewage Disposal Systems, Trees, and Other Possible Sources of Contamination of Water Supplies, by Indicating Distances and Slope with regard to one another.

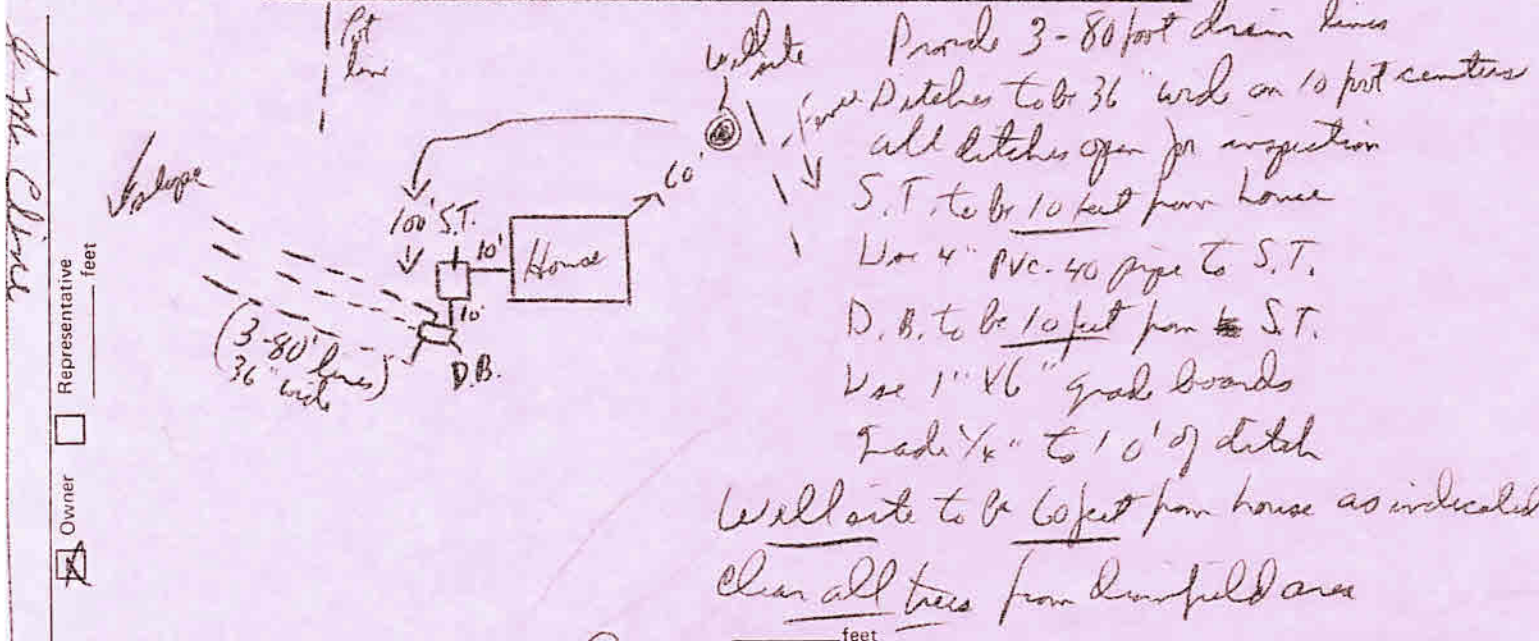

Note: Owner or his agent must notify \_\_\_\_\_ Health Department, Phone 696-2858 when installation is ready for inspection. If any Sewage Disposal System, or part thereof, is covered before being inspected by the Health Department, it shall be uncovered at the direction of the Health Director or his agent. CONDITIONS DISCOVERED DURING INSTALLATION MAY REQUIRE ADJUSTMENTS OF SYSTEM DESIGN. Changes from above specifications require Health Department approval before being made.

Based on the above information, the undersigned recommends that this permit be issued.  
 Date \_\_\_\_\_ Approved \_\_\_\_\_ (Reviewing Authority) Date 3-19-76 Signed J. M. Cline (Sanitarian or Health Director)

March 15, 1976

I, the undersigned, do hereby grant permission for James Madison Cline, whose property connects with mine, to use approximately forty-five feet of my land for field line from sewage tank.

  
Clarence W. Bowen

State of Virginia  
County of Lunenburg

I, a Notary Public for the County aforesaid, in the State of Virginia, do hereby certify that Clarence W. Bowen, whose name is signed to the writing above, bearing date on the day of March 15, 1976, has acknowledged the same before me in my county aforesaid.

Given under my hand this 15th day of March 1976.

  
Jeanne C. Kimbrough

My commission expires: April 9, 1979



# RECORD OF INSPECTION-SEWAGE DISPOSAL SYSTEM

Date 3-19-76 Case No. 21-24

Owner Rickey Lee Bowen Address Rt. 2, Box 23, South Hill, Va. Phone \_\_\_\_\_

Occupant same Address \_\_\_\_\_ Phone \_\_\_\_\_  
(Mailing Address) (Mailing Address)

Exact Location of Premises From Kenbridge on Rte. 655 to Rte. 635, left to Rte. 640, left 1 1/2 mile on right trailer.  
(Subdivision, Street or Road Name, Section or Lot No.)

## WATER SUPPLY INSPECTION

Installed according to Permit Design ☐ Yes ☒ No. Distance to nearest House Sewer 110 feet. Distance to nearest Sewage Disposal System 110 feet. (Use Form LHS-143 for Detailed inspection of Water Supply Reference Materials.)

## SEWAGE DISPOSAL SYSTEM INSPECTION

### (1) LOCATION

Allotted Area adequate ☒ Yes ☐ No. Distance from nearest lot lines 110 feet. Trees 10 feet. Water Supplies 110 feet. Buildings 10 feet.

### (2) INSTALLATION AND DESIGN

Installed according to Permit Design ☒ Yes ☐ No  
Have additional Household Appliances been added NOT on Permit:  
☐ Automatic Washer ☐ Garbage Disposal  
☐ Other \_\_\_\_\_  
(Describe)

### (3) SOIL CONDITION

Are there soil conditions now evident which indicate system may be unsatisfactory as designed: ☐ Yes ☒ No. If Yes, show adjustments required under "Remarks" below.

### (4) HOUSE SEWER LINE

Installed ☒ Yes ☐ No. Type of material APPS-40  
Size \_\_\_\_\_ Inches.

### (5) SEPTIC TANK

Constructed of pre-cast concrete  
(Kind of Material)  
Inside Dimensions Length 8 feet. Width 4 feet.  
Liquid Depth 4 feet. Depth of Air Space 12 inches.  
Inside Fittings comply with requirements ☒ Yes ☐ No.

### (6) DISTRIBUTION BOX

Watertight and equal surcharge to each line by Water Test  
☒ Yes ☐ No. Distribution Box provided with 4 (Number)  
extra outlets for future use.

### (7) SUBSURFACE ABSORPTION FIELD

Total Area in bottom of ditches 120 square feet.  
Number of ditches 3 Length of ditches 240 feet.  
Grade of ditches Minimum 2 Inches per 100 feet.  
Maximum 4 inches per 100 feet. Has system been checked by instruments (Level) ☒ Yes ☐ No  
Type aggregate used gravel  
Depth of aggregate under Tile 6 inches  
Total depth of aggregate 13 inches  
Depth of backfill over aggregate 32-36 inches

### (8) SURFACE DRAINAGE

Storm Drains from House and Basement flowing away from Subsurface Drainage Field: ☒ Yes ☐ No. Was Surface Drainage required ☐ Yes ☒ No. If Yes, has this been provided ☐ Yes ☐ No. Has area been drained by lowering Ground Water Table: ☐ Yes ☐ No. ☒ Not required.

(9) Are follow-up inspections necessary ☐ Yes ☒ No.

Septic Tank Contractor: W. T. Spence Address Brookman, Va Phone \_\_\_\_\_

This Sewage Disposal System (Is) (Is Not) Approved by Lawrenceburg County Health Department.

Date 4-2-76 Signed S. E. Perry (Sanitarian) Date \_\_\_\_\_ Approved \_\_\_\_\_ (Health Director)

Date \_\_\_\_\_ Approved \_\_\_\_\_ (Advisory Sanitarian) Date \_\_\_\_\_ Approved \_\_\_\_\_ (Reviewing Authority — Other Agency)

With proper maintenance, approved Sewage Disposal systems may be expected to function satisfactorily, provided no overloading or physical damage occurs to the system. Remarks: \_\_\_\_\_



# PERMIT TO INSTALL ☒ REPAIR, ☐ REASONS FOR REJECTION ☐ WATER SUPPLY ☐ SEWAGE DISPOSAL SYSTEM ☒

(1) Void after (12) twelve months. (2) Automatically cancelled when site conditions are changed from those shown on permit.  
 (3) Automatically cancelled should facts later become known that a potential hazard would be created by continuing installation.

FHA/VA ☐ Yes ☐ No Date 3-19-76 Case No. 21-24

Owner Rickey Lee Bowser Address Rt 2, Box 23 South Hill, Va. Phone \_\_\_\_\_  
 (Mailing Address)

Occupant same Address \_\_\_\_\_ Phone \_\_\_\_\_  
 (Mailing Address)

Exact Location of premises from Kenbridge on Rte 655 to Rte 635, left to Rte 640, left 1 1/2 mile, on right trailer  
 (Subdivision, Street or Road Name, Section or Lot No.)

FOR: ☒ Dwelling ☐ Other \_\_\_\_\_ Automatic Washing Machine ☒ Yes ☐ No Consumption 400 gal. per day  
 Actual ☒ Potential ☐ Bedrooms 2 Garbage Disposal Unit ☐ Yes ☒ No ( ☐ Actual ☒ estimated Water )  
 Additional wastes all waste to septic tank

(1) WATER SUPPLY (Existing) Class III Approved ☒ Yes ☐ No Other \_\_\_\_\_  
 (To be installed) Class \_\_\_\_\_ ft. to be grouted \_\_\_\_\_ ft.

(Unless supported by positive evidence Class III is to be considered as to be installed.)

(2) SOIL STUDY Naturally drained, suitable by sight ☒ Yes ☐ No Technical Classification \_\_\_\_\_ (If Known)  
 Estimated Percolation Rate 1-10 ☐ 11-25 ☐ 26-50 ☒ > 51 ☐ Percolation Test Required ☐ Yes ☒ No Rate \_\_\_\_\_  
 (Minutes per inch) (Minutes per inch to nearest 10 minutes)  
 Depth to Grey Mottles \_\_\_\_\_ inches (estimate over 4 ft.) OTHER \_\_\_\_\_  
 Surface drainage required ☐ Yes ☒ No OTHER DRAINAGE \_\_\_\_\_

(3) HOUSE SEWER LINE Size 4 inches. Type of material required PVC-40. Distance from Water Supply 110 feet.

(4) DETAILS OF CONSTRUCTION Watertight Septic Tank of concrete Material Liquid Capacity 1000 gallons.  
 Inside Dimensions Length 8 feet. Width 4 feet. Liquid Depth 4 feet. Depth of Air Space 15 feet.

SUBSURFACE ABSORPTION FIELD Number of square feet required 720 Type aggregate required gravel

(5) Depth of aggregate from base of tile to bottom of ditches 6 inches. Allowable fall 2 to 4 inches.  
 Total aggregate minimum depth 13 inches or more. Depth of drainfield to be 48 inches from surface of original ground.  
 Distance from well to septic tank 110 feet; distance from well to drainfield 110+ feet.

Rough Sketch of Premises (including adjacent properties if pertinent, Showing Location of Lot Line, Buildings, Water Supplies, Sewage Disposal Systems, Trees, and Other Possible Sources of Contamination of Water Supplies, by Indicating Distances and Slope with regard to one another.)

Rte 640

ROAD


House

well existing

← 110' →

Provide 3-80 foot drain lines  
 Ditches to be 36" wide on 10 foot centers  
 all ditches open for inspection  
 S.T. to be 10 feet from trailer  
 Use 4" PVC-40 pipe to S.T.  
 D.B. to be 10 feet from S.T.  
 Use 1" X 6" grade boards  
 grade 1/4" to 10' of ditch

slope ←

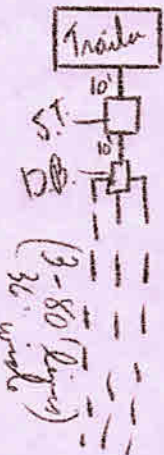

James D. King

696-2858

Note: Owner or his agent must notify \_\_\_\_\_ Health Department, Phone \_\_\_\_\_ when installation is ready for inspection. If any Sewage Disposal System, or part thereof, is covered before being inspected by the Health Department, it shall be uncovered at the direction of the Health Director or his agent. CONDITIONS DISCOVERED DURING INSTALLATION MAY REQUIRE ADJUSTMENTS OF SYSTEM DESIGN. Changes from above specifications require Health Department approval before being made.

Based on the above information, the undersigned recommends that this permit be issued. 3-19-76 Signed S.E. King RB  
 Approved \_\_\_\_\_ (Reviewing Authority) Date \_\_\_\_\_ Signed \_\_\_\_\_ (Sanitarian or Health Director)