

## Rockingham County Department of Public Health

Permit Number ZP031803-1☒ Improvement Permit 3-18-08 Expiration Date -- Transferable☒ Authorization for Wastewater System Construction (Expires five years from date of issuance of Improvement Permit)☒ Operation Permit II System Classification Type \_\_\_\_\_ Authorization to Connect to Wastewater System

TAX PIN NUMBER: 116016

APPLICANT NAME: AHERON

STEVE

## PROPERTY INFORMATION

Road Name: GIDEON GROVE CHURCH

Subd/Park:

Section :

Lot # :

Lot Size : 4+

## OWNER INFORMATION

AHERON

STEVE

2227 GIDEON GROVE CHURCH RD

STOKESDALE

NC 27357

336 643 7722

Water Supply : PRIVATE WELL

ELLISBORO RD, L ON GIDEON GROVE - ALTERNATE PH: 508-3870

☒ House 4 #bedrooms  
 \_\_\_\_\_ Singlewide \_\_\_\_\_ #people  
 \_\_\_\_\_ Doublewide \_\_\_\_\_ basement  
 \_\_\_\_\_ Commercial \_\_\_\_\_ basement w/  
 \_\_\_\_\_ Food Service \_\_\_\_\_ plumbing  
 \_\_\_\_\_ Seats \_\_\_\_\_ addition  
 \_\_\_\_\_ Other \_\_\_\_\_

## TYPE SYSTEM

\_\_\_\_\_ New \_\_\_\_\_ Repair ☒ Expansion  
☒ Conventional \_\_\_\_\_ Existing  
 \_\_\_\_\_ L.P.P. \_\_\_\_\_ Pump  
 \_\_\_\_\_ Saprolite .1956(6) \_\_\_\_\_  
 \_\_\_\_\_ Innovative \_\_\_\_\_  
 \_\_\_\_\_ Other \_\_\_\_\_

IMP NAME

DATE

Billingsley 30 Apr 03

INSTALLER

INSTALLATION CONDITIONS

- Attach to end of last  
 line  
 - use existing room for  
 new line

INSTALL ON CONTOUR  
 LANDSCAPE PROMPTLY

LAYOUT

SPECIFICATIONS

INSTALLED

~~Existing~~  
#800

Septic Tank

Existing

900 ft<sup>2</sup>

Pump Tank

900'

P. Well

Drainfield sq ft

Existing well

1+

Water Supply

# of lines 4 lines + 8 steps

300'

Total length of lines

24"

Trench depth

\* 36"

36"

Trench width

36"

6"

Depth of rock below pipe

6"

12"

Total rock depth

12"

&gt; 15'

Distance to foundation

20'

&gt; 10'

Distance to property lines

10' front

&gt; 50'

Distance to well


Existing tank - 60'

—


Watershed

## AUTHORIZATION FOR WASTEWATER SYSTEM CONSTRUCTION

## OPERATION PERMIT

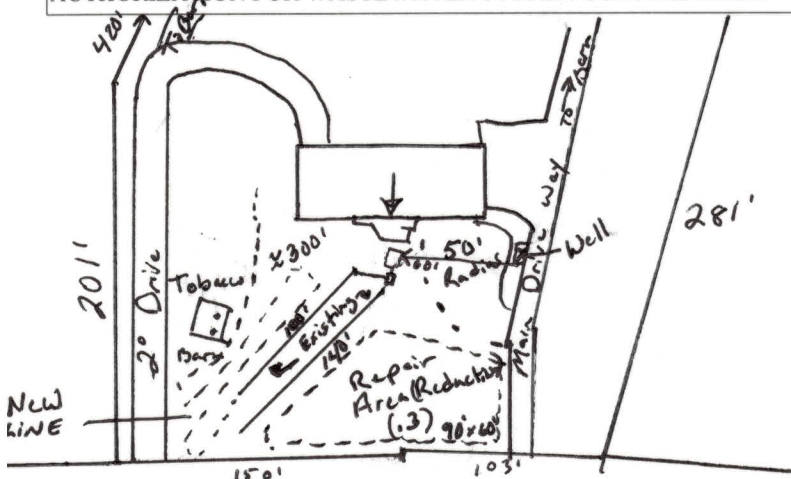

\*old line deep forced new lines deep - soil good

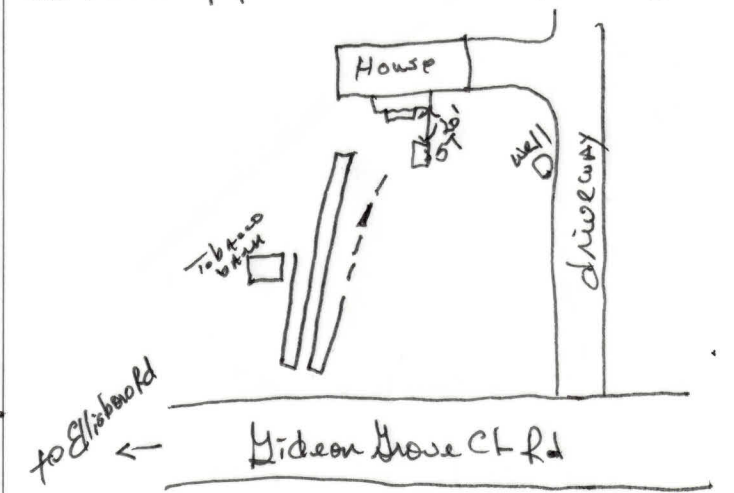

Gideon Grove Church Rd

Signed: Robert M. Jones, R.S. Date: 3-18-03Signed: Robert M. Jones, R.S. Date: 30 Apr 03

APPEALS: By written petition to the Office of Administrative Hearings, 6714 Mail Service Ctr., Raleigh, North Carolina 27699-6714. In accordance with GS.150B-23(a) THIS PERMIT may be suspended or revoked upon a finding that a violation of ...this Chapter, The Rules... or a condition imposed upon the permit has occurred...Also upon a finding that its issuance was based on incorrect or inadequate information...GS.130A-23(a)(c)(d). Septic Tanks require effluent filters, and access devices... GS.130A-335.1.

EH09TH96 SAM